



4076



SIEVE ANALYSIS

Report No. 1119-N-04-A-27


Client: Nick Brookes
 Site: Wardle Depot
 Location: Stockpile
 Date Sampled: 20/10/11
 Sampled from: Stockpile
 Supplier: Client
 Description: Recycled Type 1 Subbase

Laboratory Ref: Lab/11/3982
 Client Ref. Tr7/20/10
 Mass (kg): 44
 Source: Site

Material Specification: SHW Table 8/5 (Overall Range)
 Sampled by: Client
 Date received: 24/10/11
 Sample type: Bulk
 Method of Preparation:

Remarks: Sample complies with grading specification

BS Sieve (mm)	Passing (%)	Material Specification		
90				
80				
75				
63	100	100		
40	88			
31.5	78	75	-	99
20	69			
16	63	43	-	81
14	59			
10	48			
8.0	43	23	-	66
6.3	37			
4.0	31	12	-	53
2.0	26	6	-	42
1.0	24	3	-	32
0.500	21			
0.250	14			
0.125	7			
0.063	4.7	0	-	9

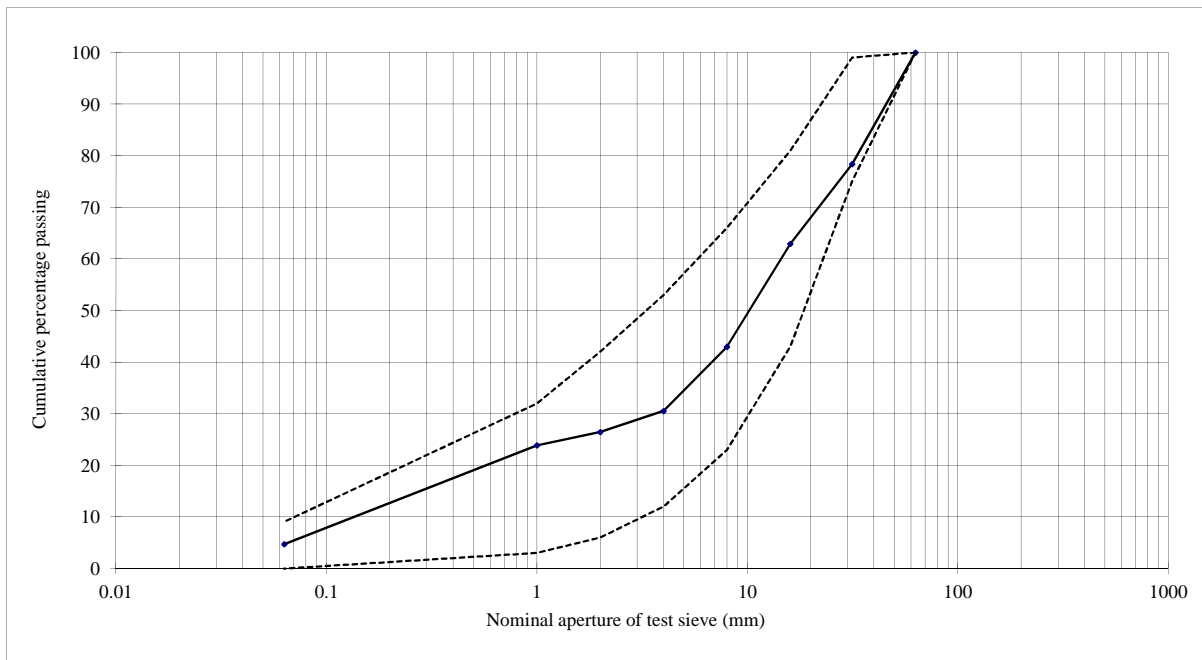

Certified that the Particle Size Distribution was determined in accordance with EN 933-1

Signed _____ () M. Hayes (Laboratory Manager)
 () D.Foster(Assistant Laboratory Manager)
 (X) J.Hopkinson(Senior Technician)